



PLAN VIEW

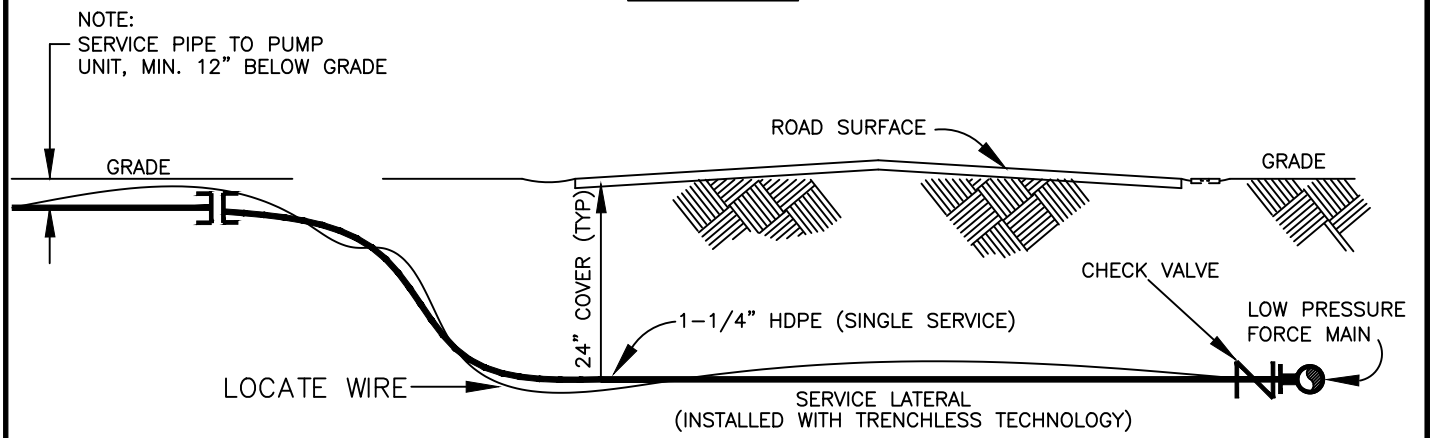

**TYPICAL ROAD CROSSING SECTION VIEW
(N.T.S.)**

NOTES:

1. ACTUAL LOCATIONS OF SERVICES SHALL BE DETERMINED IN FIELD BY RESIDENT ENGINEER DEPENDING UPON EXISTING CONDITIONS & LOCATION OF EXISTING SEPTIC TANK.
2. ALL SERVICE LINES MUST HAVE LOCATE WIRE FROM MAIN TO TANK.
3. ALL SERVICE LATERALS MUST BE INSTALLED NO DEEPER THAN THE EXISTING UTILITIES.

 <p>STANDARD UTILITY DETAILS City of Stuart Utilities & Engineering Department</p> <p>121 S.W. Flagler Avenue, Stuart, Florida 34994</p>	SINGLE SERVICE CONNECTION	
	<p>DATE: OCTOBER 2021</p> <p>FILE NAME: 2021 COS Std Details.dwg</p>	<p>SHEET NUMBER</p> <p style="text-align: center;">LP-4</p>